

ISO DEC 2500

THERMAL INSULATED DUCTING

The **ISO DEC 2500** series consists of an aluminium laminate inner duct, thermally insulated with a glass wool layer and provided with an aluminium laminated outer duct. The thermal insulation is suitable for preventing condensation and minimizing heat loss and loss of cold.

APPLICATION

- Steam return lines
- Insulation in ventilation and air supply systems
- Air conditioning systems
- Thermic insulation in order to prevent heat loss or loss of cold
- Preventing of condensation in ventilation systems

SPECIFICATIONS

Article code: DIY{Ø}
 Temperature range:
 Inner duct: -30 °C to 250 °C
 Outer duct: -30 °C to 250 °C
 Operating pressure: up to +3000 Pa
 Operating air velocity: max. 30 m/s
 Min. bending radius: 0.58 x Ø + 25mm
 Standard diameter range: 82 – 254 mm
 Bigger diameters in 50mm insulation
 Standard length: 6 mtr

CONSTRUCTION

Inner duct: Alu/poly laminate
 Glass wool blanket: 25mm, 16kg/m³
 Outer duct: Alu/poly laminate
 R-value glass wool: 0.65 m² K/W (ASTM C177-76)
 Appearance: Aluminium

CLASSIFICATIONS

EU (EN 13501-1): A2-s1,d0
 UK (BS476): Part 6, 7 and 20
 FR (NF): M0/M0
 Marine certified MED


Regulation or protocol
 French VOC Regulation

Conclusion



Version of regulation or protocol
 Regulation of March and May 2011
 (DEVL1101903D and DEVL1104875A)

PRESSURE LOSS (STRAIGHT DUCT)

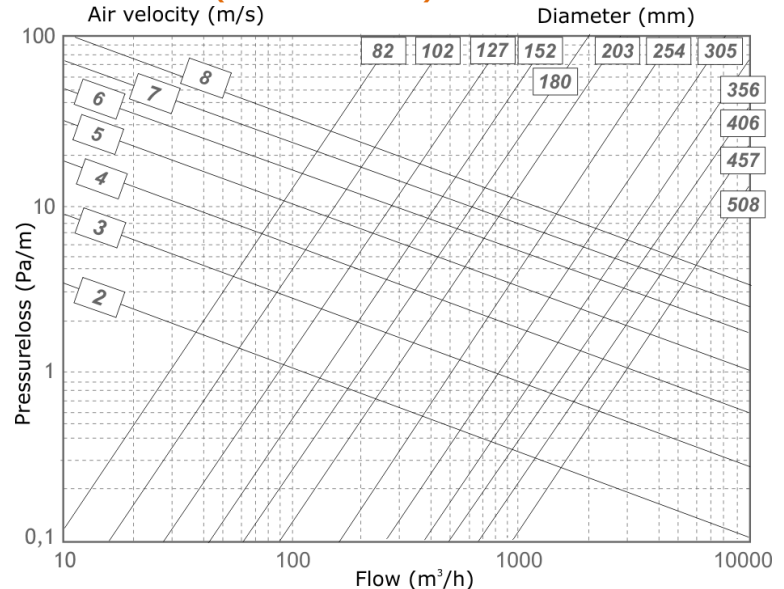

The **ISO DEC 2500** fulfills all the requirements and are classified as specified within EN 13180: *Ventilation for buildings – Ductwork - Dimensions and mechanical requirements for flexible ducts.*

The **ISO DEC 2500** is also available, on request, with a 50 mm glass wool layer, the article number is: DIY50{Ø}
 R-value glass wool: 1.3 (50 mm) m² K/W (ASTM C177-76). Diameter range: 082mm upto 508mm

Reach/RoHs Compliant

Directive 2011/65/EU RoHS
 Phthalates according to 1907/2006/EC REACH
 Test result: Pass - The test items meets the requirements of the test specification



LIABILITY:

The information contained in this brochure was current on the publication date. DEC INTERNATIONAL reserves the right to make changes in details at any time without prior notice. In order to avoid misunderstandings, any interested party is advised to contact DEC INTERNATIONAL checking for any changes in materials and/or information after this brochure was published.

PLEASE NOTICE:

The consultant is responsible for the actual installation and mounting of the product. The mentioned values with respect to temperatures are not appropriate to be used to determine the physical properties. These properties are also dependent on humidity and the temperature of the air inside and outside of the H.V.A.C. system.

TRADEMARKS:

ISO DEC, the DEC logo and DEC International are trademarks, or registered trademarks of Dutch Environment Corporation BV in the Netherlands and/or other countries.

RESTRICTIONS:

The ISO DEC ducts are not suitable for discharging combustion products from open fireplaces and oil-fired boilers. Neither are the ISO DEC ducts suitable for transporting air with a high concentration of acid and base.

